

# SERIES: VFM-30-W | DESCRIPTION: DC POWER LINE FILTER

#### FEATURES

- compact
- high efficiency 98%
- meet IEC/EN61000-4 standard
- CISPR22/EN55022 compliant
- DIP, Chassis and DIN Rail mounting version
- input voltage protection





#### **SPECIFICATIONS**

parameter	conditions/description	min	typ	max	units
input voltage		18	48	75	Vdc
output power				30	W
no load input current	at 48 Vdc			10	mA
efficiency	at 48 Vdc, full load		98		%
isolation voltage	+Vin to GND, -Vin to GND, at 1 minute and 500 leakage current 5 mA max				Vac
conducted emissions	CISPR22/EN55022, 150 kHz ~ 30 MHz class B				
radiated emissions	CISPR22/EN55022, 30 MHz ~ 1 GHz class B				
ESD	IEC/EN61000-4-2, air $\pm 8$ kV, contact $\pm 6$ kV, class B				
radiated immunity	IEC/EN61000-4-3, 10 V/m, class A				
EFT/burst	IEC/EN61000-4-4, ±4 kV(5 kHz, 100 kHz), class B				
surge	IEC/EN61000-4-5, ±2 kV (1.2μs/50μs 2Ω)/±4 kV (1.2 μs/50 μs 12 Ω), class B				
conducted immunity	IEC/EN61000-4-6, 10 Vr.m.s, class A				
MTBF	as per MIL-HDBK-217F, 40°C	1,000,000		hours	
RoHS	yes				
operating temperature		-40		85	°C
storage temperature		-55		125	°C
storage humidity	non-condensing	5		95	%

#### **PART NUMBER KEY**

.....


FM-30-W Base Number

Mounting Style: D = board mount T = chassis mount DIN = DIN-rail mount

### **SOLDERABILITY**<sup>2</sup>

parameter	conditions/description	min	typ	max	units
hand soldering	for 3~5 seconds	350	360	370	°C
wave soldering	see wave soldering profile			260	°C

Note: 2. For board mount models only.

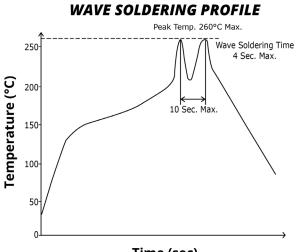

#### Time (sec)


### **MECHANICAL**


parameter	conditions/description	min	typ	max	units
dimensions	board mount: $53.80 \times 28.80 \times 19.00$ [2.118 x 1.134 x 0.748 inch] chassis mount: 76.00 x 31.50 x 27.80 [2.992 x 1.240 x 1.094 inch]			mm mm	
	DIN-Rail mount: 76.00 x 31.50 x 32.40 [2.992 x 1.240 x 1.276 inch]				mm
case material	black flame-retardant heat-proof epoxy resin (UL94V-0)				
weight	board mount		50		g
	chassis mount		70		g
	DIN-rail mount		90		g

## **MECHANICAL DRAWING (BOARD MOUNT)**

units: mm [inch] tolerance: ±0.50[±0.020] pin diameter tolerance: ±0.10[±0.004]

PIN CONNECTIONS			
PIN	Function		
1	GND		
2	-Vin		
3	+Vin		
4	+Vout		
5	-Vout		






## **MECHANICAL DRAWING (CHASSIS MOUNT)**

units: mm [inch] tolerance: ±0.50[±0.020]

wire range: 24~12 AWG tightening torgue: 0.4 N\*m max

PIN CONNECTIONS			
PIN	Function		
1	GND		
2	-Vin		
3	+Vin		
4	+Vout		
5	-Vout		

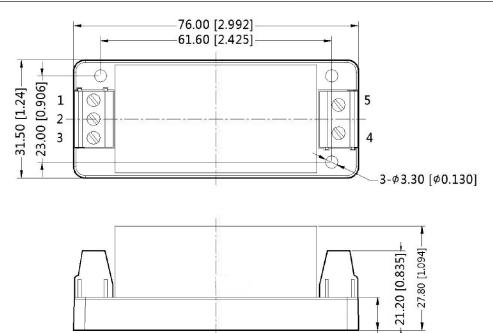


8.80 [0.346]-

# **MECHANICAL DRAWING (DIN-RAIL MOUNT)**


units: mm [inch] tolerance: ±0.50[±0.020]

installed on DIN rail TS35 wire range: 24~12 AWG tightening torgue: 0.4 N\*m max

PIN CONNECTIONS		
PIN	Function	
1	GND	
2	-Vin	
3	+Vin	
4	+Vout	
5	-Vout	

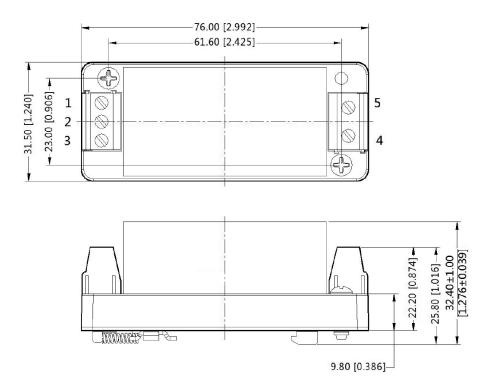


## **APPLICATION CIRCUIT**

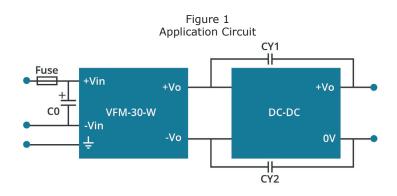

Recommended External Circuit Components			
FUSE	choose according to power module datasheet		
C0	400 µF / 200 V, electrolytic		
CY1, CY2	1 nF / 2 kV		

Figure 2 Non-supported Application for Module

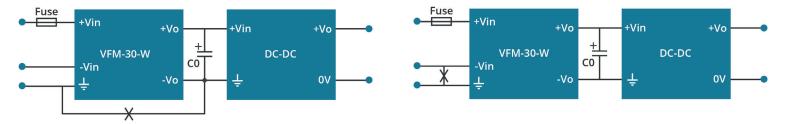

### **REVISION HISTORY**

rev.	description	date
1.0	initial release	12/17/2018
1.01	packaging removed	05/14/2021
1.02	circuit figures updated	01/14/2022

The revision history provided is for informational purposes only and is believed to be accurate.



a bel group

Headquarters 20050 SW 112th Ave. Tualatin, OR 97062 800.275.4899

Fax 503.612.2383 cui.com techsupport@cui.com

CUI offers a two (2) year limited warranty. Complete warranty information is listed on our website.

.....

CUI reserves the right to make changes to the product at any time without notice. Information provided by CUI is believed to be accurate and reliable. However, no responsibility is assumed by CUI for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

.....

CUI products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.