

#### **DESCRIPTION:** AC-DC POWER SUPPLY SERIES: VMS-200C

#### **FEATURES**

- universal input voltage (85 ~ 264 Vac)
- active power factor correction
- certified to 60601, 60335, and 61558 safety standards
- suitable for safety class I or class II installations
- over voltage, over current, over temperature, and short circuit protections
- adjustable output via trim POT
- low leakage current (< 0.1 mA)</li>
- low standby power consumption (0.5 W)



	-				
	•	output current	output power	ripple and noise <sup>2</sup>	efficiency <sup>3</sup>
(Vdc)	range <sup>1</sup> (Vdc)	max (A)	max (W)	<b>max</b> (mVp-p)	typ (%)
12	11.8 ~ 12.6	16.6	200	60	93
15	14.7 ~ 15.8	13.3	200	100	93
24	23.5 ~ 25.2	8.33	200	100	94
27	26.5 ~ 28.4	7.40	200	100	94
36	35.2 ~ 37.8	5.56	200	100	94
48	47.1 ~ 50.4	4.16	200	100	94
	(Vdc) 12 15 24 27 36	(Vdc) (Vdc)   12 11.8 ~ 12.6   15 14.7 ~ 15.8   24 23.5 ~ 25.2   27 26.5 ~ 28.4   36 35.2 ~ 37.8	voltage current max (Vdc)   12 11.8 ~ 12.6 16.6   15 14.7 ~ 15.8 13.3   24 23.5 ~ 25.2 8.33   27 26.5 ~ 28.4 7.40   36 35.2 ~ 37.8 5.56	voltagecurrentpowerrange1maxmax(Vdc)(Vdc)(A)1211.8 ~ 12.616.62001514.7 ~ 15.8132002423.5 ~ 25.28.332726.5 ~ 28.47.403635.2 ~ 37.85.56	voltagecurrentpowerand noise2range1maxmaxmaxmax(Vdc)(Vdc)(A)(W)(mVp-p)1211.8 ~ 12.616.6200601514.7 ~ 15.813.32001002423.5 ~ 25.28.332001002726.5 ~ 28.47.402001003635.2 ~ 37.85.56200100

1. When adjusting the output voltage care should be taken never to exceed the stated output power or output current of the unit.


At full load, nominal input, 20 MHz bandwidth oscilloscope, tip & barrel method, output terminated with 10 uF electrolytic and 0.1 uF ceramic capacitors. Under light load conditions (<15%) the measurement may double in an effort to maximize converter efficiency.</li>

3. At 230 Vac.

Notes:

## **PART NUMBER KEY**

.....

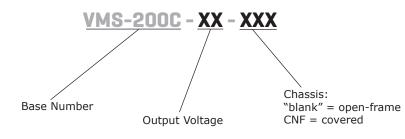

### INPUT

parameter	conditions/description	min	typ	max	units
voltage	ac input dc input	85 120		264 370	Vac Vdc
frequency		47		63	Hz
current	at 115 Vac at 230 Vac			3.0 2.0	A A
inrush current	at 115 Vac, cold start at 230 Vac, cold start		40 75		A A
leakage current	at 240 Vac			0.1	mA
power factor correction	at 115 Vac, full load at 230 Vac, full load	0.99 0.95			
no load power consumption			0.5		W

## OUTPUT

parameter	conditions/description	min	typ	max	units
	12 Vdc output model			6,000	μF
	15 Vdc output model			5,000	μF
autnut conscitonce	24 Vdc output model			3,200	μF
output capacitance	27 Vdc output model			2,400	μF
	36 Vdc output model			2,000	μF
	48 Vdc output model			1,600	μF
initial set point accuracy	full load		±1		%
line regulation	rated load		±0.5		%
load regulation	0 ~ 100% load		±0.5		%
hold-up time	at 230 Vac, 25°C		12		ms
temperature coefficient			±0.03		%/°C
fan nower	15 Vdc output models, 6W max	20.4	24	27.6	V
fan power	other output models, 6W max	10.2	12V	13.8	V

# PROTECTIONS

parameter	conditions/description	min	typ	max	units
	output shutdown, latching				
	12 Vdc output model		16		Vdc
	15 Vdc output model		20		Vdc
over voltage protection	24 Vdc output model		32		Vdc
	27 Vdc output model		35		Vdc
	36 Vdc output model		50		Vdc
	48 Vdc output model		60		Vdc
over current protection	hiccup, auto recovery	110			%
short circuit protection	continuous, auto recovery, hiccup				
over temperature protection	output shutdown, auto recovery				

.....

.....

max

units

parameter	conditions/description
isolation voltage	input to ground for 1 minute; <10 mA input to output for 1 minute; <10 mA output to ground for 1 minute; <10 mA
safety approvals	certified to 60601: ES, EN certified to 60335: EN

## **SAFETY & COMPLIANCE**

isolation voltage	input to ground for 1 minute; <10 mA input to output for 1 minute; <10 mA	1,500 4,000	Vac Vac
	output to ground for 1 minute; <10 mA	1,500	Vac
	certified to 60601: ES, EN certified to 60335: EN		
safety approvals	certified to 61558: EN		
safety class	class I (with PE), class II (without PE)		
conducted emissions <sup>1</sup>	CISPR32/EN55032 CLASS B		
radiated emissions <sup>1</sup>	CISPR32/EN55032 (Class B for safety class I i	nstallations; Class A for safety cl	ass II installations)
harmonic current	IEC/EN61000-3-2 CLASS D		
ESD	IEC/EN 61000-4-2 Contact ±8KV/Air ±15KV p	erf. Criteria A	
radiated immunity	IEC/EN 61000-4-3 10V/m perf. Criteria A		
EFT/burst	IEC/EN 61000-4-4 ±4KV perf. Criteria A		
surge	IEC/EN 61000-4-5 ±2KV/±4KV perf. Criteria A	A	
conducted immunity	IEC/EN61000-4-6 10 Vr.m.s perf. Criteria A		
voltage dips and interruptions	IEC/EN61000-4-11 0%, 70% perf. Criteria B		
MTBF	as per MIL-HDBK-217F	300,000	hours
RoHS	yes		

min

typ


1. The power supply is considered a component of the end system. All EMC performance has been tested on a metal plate with the dimensions 360 x 360 x 1 mm. The power supply must be integrated into the end system for proper electromagnetic compatibility testing. Notes:

## **ENVIRONMENTAL**

.....


parameter	conditions/description	min	typ	max	units
operating temperature	see derating curves	-40		70	°C
storage temperature		-40		85	°C
operating humidity	non-condensing	20		90	%
storage humidity	non-condensing	10		95	%

## **DERATING CURVES**

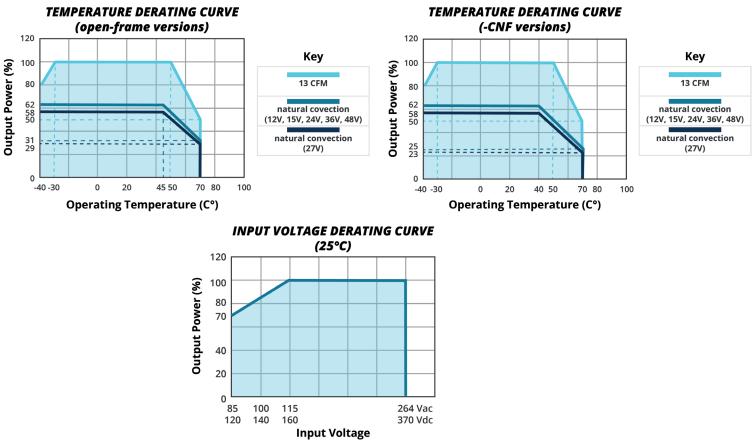

Note: With an AC input voltage between 85 ~ 115 and a DC input between 120 ~ 160 Vdc the output power must be derated as per the temperature derating curve.

### **EFFICIENCY CURVES**

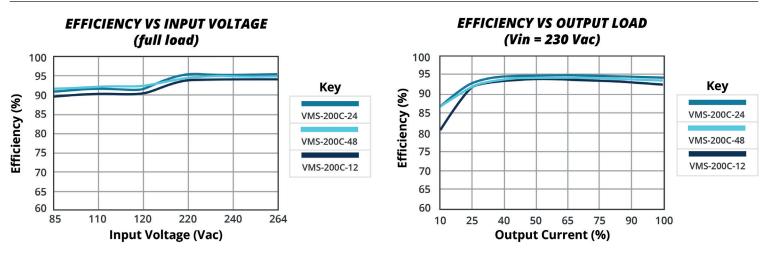


### **MECHANICAL**


parameter	conditions/description	min	typ	max	units
dimensions	open frame models: $101.6 \times 50.8 \times 25.4$ [4.0 : covered models: $103.4 \times 62.0 \times 37.0$ [4.07 >	x 2.0 x 1.0 inch] x 2.440 x 1.456 inc	ch]		mm mm
weight	open frame models covered models		175 260		g g
cooling	natural convection (no integrated fan)				

#### **MECHANICAL DRAWING**


#### **Open-frame**

units: mm [inch] general tolerance: ±1.00 [±0.039]

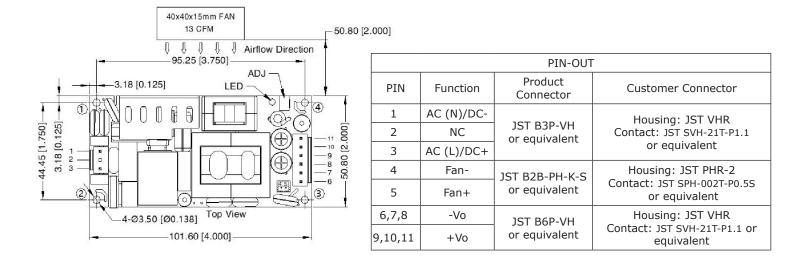



.....



Position	Screw Spec.	L (recommended)	Torque
1~4	M3	6mm	0.4 N∙m


Note: 1. Class I system (), () positions must be connected to the protective earth ground (()). 2. Class II system () (3) positions must be connected together. 3. It is recommended that a minimum distance of 10mm be placed between the PCB edge

and all other components.

# **MECHANICAL DRAWING (CONTINUED)**

#### Covered

units: mm [inch] general tolerance: ±1.00 [±0.039]

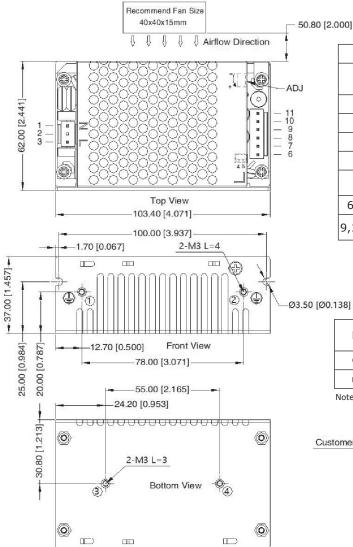


	PIN-OUT						
PIN	Function	Product Connector	Customer Connector				
1	AC (N)/DC-	JST B3P-VH	Housing: JST VHR				
2	NC		JST B3P-VH or equivalent	Contact: JST SVH-21T-P1.1			
3	AC (L)/DC+	or equivalent	or equivalent				
4	Fan-	JST B2B-PH-K-S	Housing: JST PHR-2				
5	Fan+	or equivalent	Contact: JST SPH-002T-P0.5S or equivalent				
6,7,8	-Vo	JST B6P-VH	Housing: JST VHR				
9,10,11	+Vo	or equivalent	Contact: JST SVH-21T-P1.1 or equivalent				

#### Ø3.50 [Ø0.138]

Position	Screw Spec.	L (recommended)	Torque
1~2	M3	4mm	0.4 N∙m
3~4	M3	3mm	0.4 N∙m

Note: 1. Safety Class I integrations require the metal case to be securely fastened to protective earth ground (\_\_\_).

Customer System Power Case



## **REVISION HISTORY**

rev.	description	date
1.0	initial release	06/08/2021
1.01	OVP updated	06/15/2021
1.02	derating curve updated	01/31/2022
1.03	UKCA mark added	06/13/2022
1.04	medical icon added	05/04/2023

The revision history provided is for informational purposes only and is believed to be accurate.



a bel group

Headquarters 20050 SW 112th Ave. Tualatin, OR 97062 800.275.4899

Fax 503.612.2383 cui.com techsupport@cui.com

CUI offers a two (2) year limited warranty. Complete warranty information is listed on our website.

.....

CUI reserves the right to make changes to the product at any time without notice. Information provided by CUI is believed to be accurate and reliable. However, no responsibility is assumed by CUI for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

.....

CUI products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.